
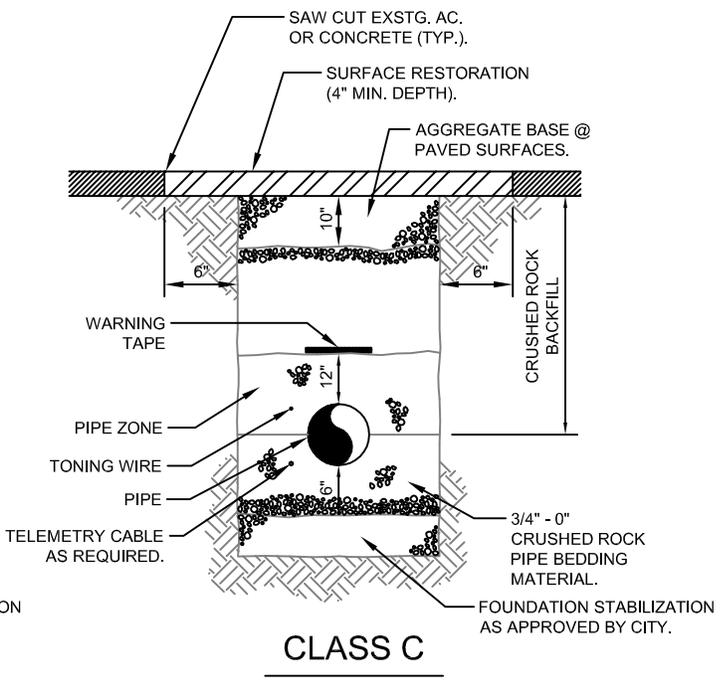


NOTE: WIDTH OF TRENCH TO BE I.D. OF PIPE PLUS 16" FOR PIPE UP TO 24" DIA. AND I.D. OF PIPE PLUS 24" FOR PIPE LARGER THAN 24"

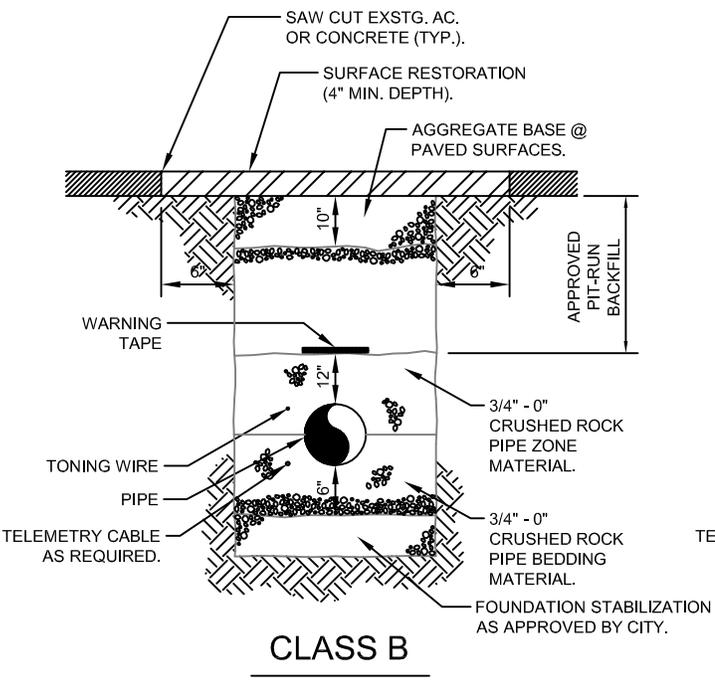

City of Sisters • Standard Detail

STANDARD TRENCHES

SCALE:	NONE
DRAWN BY:	EH
APPROVED BY:	PB
REVISION DATE:	12/03/2013

DRAWING NO.
1-1